

LEGAL NOTICE No. 80

REPUBLIC OF TRINIDAD AND TOBAGO

THE PETROLEUM ACT, CHAP. 62:01

NOTICE


ISSUED BY THE MINISTER OF ENERGY AND NATURAL RESOURCES UNDER SECTION 7(1) OF THE PETROLEUM ACT, CHAP. 62:01

IN ACCORDANCE with the provisions of section 7(1) of the Petroleum Act, Chap. 62:01 notice is hereby given that the National Gas Company of Trinidad and Tobago Limited has made written application to the Minister of Energy and Natural Resources for a Pipeline Licence to lay a 50 mm (2 inch) gas pipeline from the Churchill-Roosevelt Highway to the compound of Antilles Chemicals Limited, Trincity and subject to consideration of any objections which may be received by him pursuant to this Notice, the Minister of Energy and Natural Resources proposes to issue to the National Gas Company Limited a Pipeline Licence to construct, install, maintain and operate the pipeline described in the Schedule hereunder along the route detailed and shown on the map attached.

Any person who objects to the laying of such a pipeline on the grounds specified in section 8 of the Petroleum Act is hereby invited to give notice of his objections and of the grounds on which he relies in support thereof to the Minister of Energy and Natural Resources within thirty days of the publication of this Notice.

SCHEDULE REFERRED TO ABOVE

<i>Route</i>	From the Churchill-Roosevelt Highway along the road East of Johnson and Johnson Limited in a northerly direction until Tissue Drive, at which point it will run in an easterly direction along Tissue Drive and into the compound of Antilles Chemicals Limited, Trincity.
<i>Length</i>	640 m (2,100 feet).
<i>Specifications of pipeline</i>	50 mm (2 inch) normal diameter, thickness 5.5 mm (0.218 inch) API 5L-B seamless line pipe.
<i>Fabrication and coating</i>	The line pipe will be welded together in accordance with API code 1104 and subject to 100 per cent X-ray inspection. All joints will be cleared and primed with fast drying synthetic primer and will be wrapped with an asphalt enamel tape. Sacrificial anodes will be attached to the pipeline for cathodic protection.
<i>Depth of line</i>	The pipeline will be buried a minimum of 1.22 m (4 ft.) below the surface on normal grade and a minimum of 0.6 m (2 ft.) below drainage trenches and water courses.
<i>Fluid for Transmission</i>	Natural Gas.

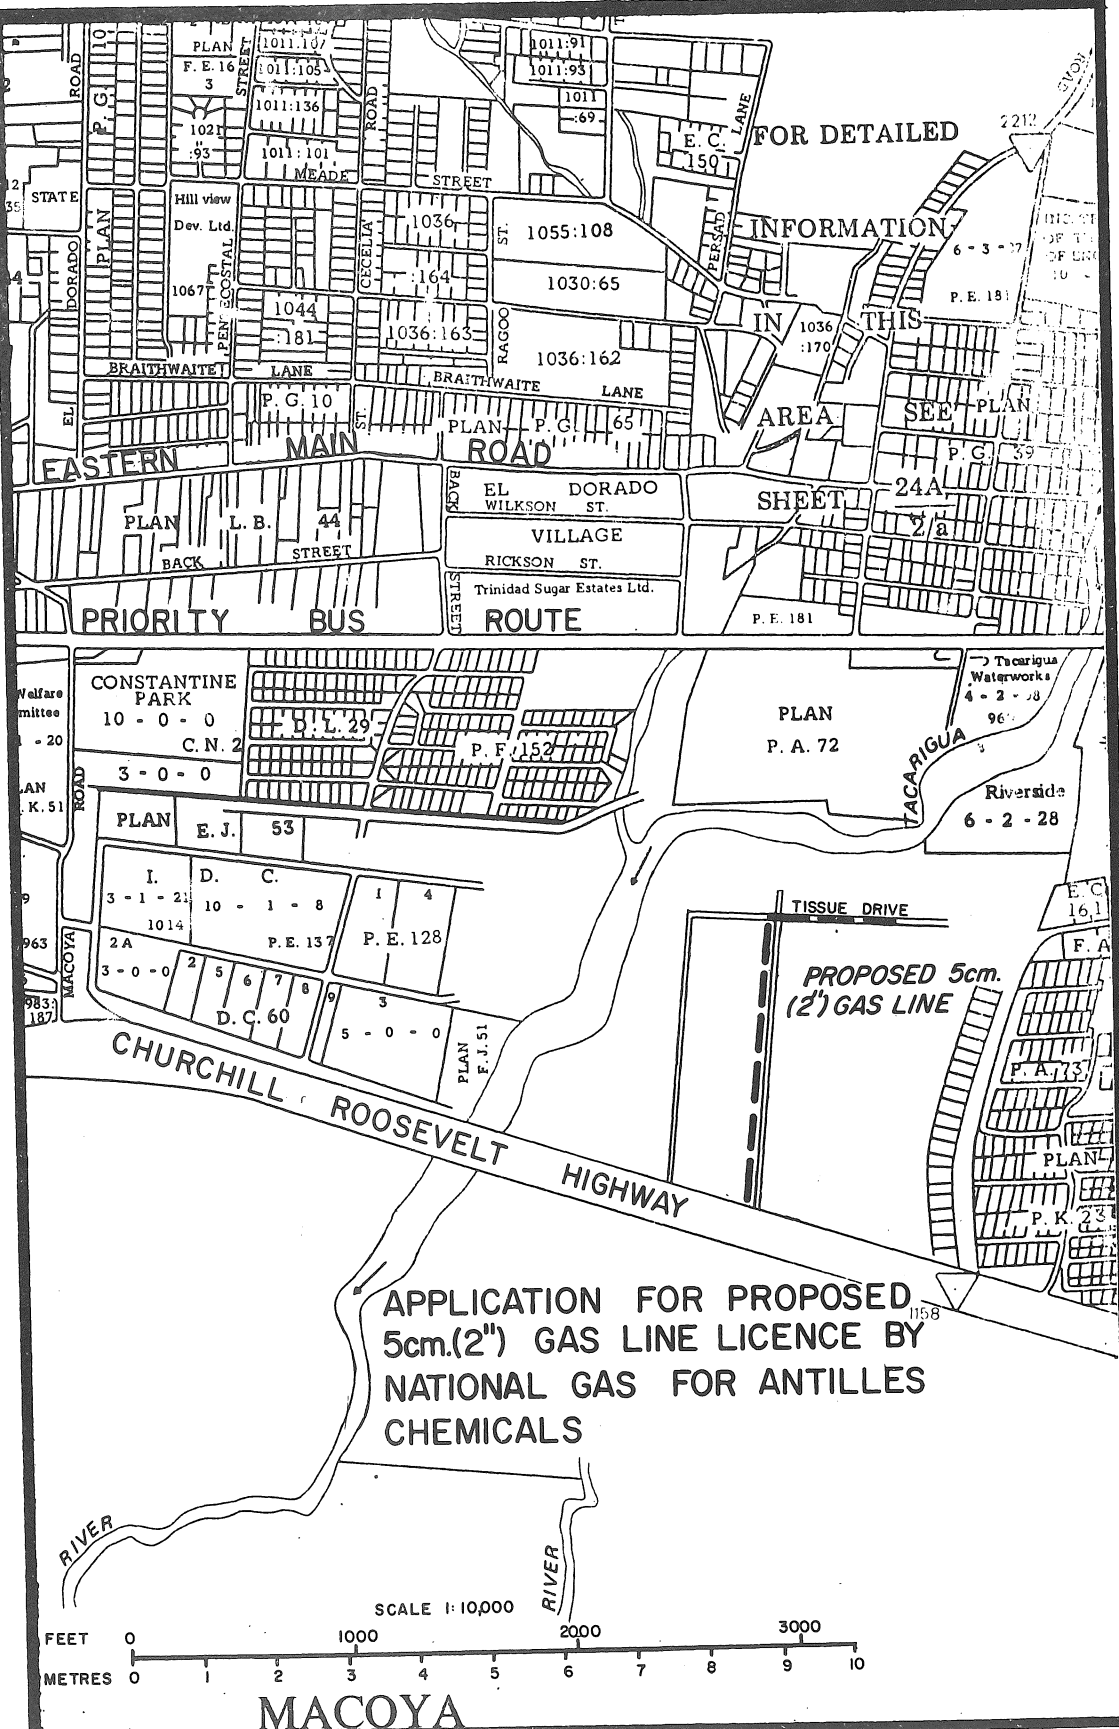

FOR DETAILED
INFORMATION

IN THIS
AREA SEE PLAN
SHEET 24A

PRIORITY BUS ROUTE

VILLAGE
RICKSON ST.
Trinidad Sugar Estates Ltd.

CONSTANTINE PARK
10-0-0
C.N. 2
3-0-0

PLAN
P. A. 72

TACARIGUA
Riverside
6-2-28


PLAN E. J. 53

TISSUE DRIVE
PROPOSED 5cm.
(2") GAS LINE

CHURCHILL ROOSEVELT HIGHWAY

APPLICATION FOR PROPOSED
5cm.(2") GAS LINE LICENCE BY
NATIONAL GAS FOR ANTILLES
CHEMICALS

SCALE 1:10,000



MACOYA



<i>Operating Pressure</i>	20.7 bars (300 psig).
<i>Estimated capacity</i>	1,500 m ³ /day (53,000 scfd).
<i>Owner of the land over which line will pass</i>	Home Construction Limited.
<i>Cost</i>	\$138,000 T.T.

Dated this 3rd day of April, 1985.

P. MANNING
Minister of Energy and Natural Resources